




NO.	DATE	REVISION / REMARKS

STD DETAILS
 SHEET NUMBER
 0
 OF
 0
 SEAL

THIS SPACE INTENTIONALLY LEFT BLANK


THIS SPACE INTENTIONALLY LEFT BLANK

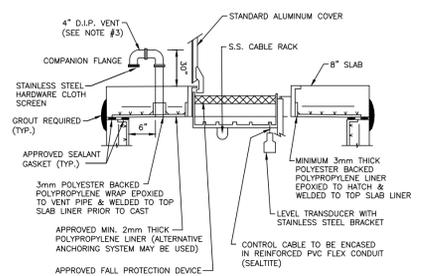

- NOTES:
1. A FIELD WELDED CAP STRIP OVER THE WETWELL/TOP SLAB JOINT IS NOT REQUIRED.
 2. THE ULTRASONIC LEVEL TRANSDUCER SHALL BE LOCATED NEAR THE CORNER OF THE ACCESS OPENING, OPPOSITE OF PUMP/GUIDE RAILS AND OPPOSITE OF SENARY INFLOW INVERT. THE CONTROL WIRE SHALL BE ENCASED IN 3/4\"/>
 - 3. THE WETWELL VENT SHALL BE LOCATED OPPOSITE OF THE ACCESS GATE.

LIFT STATION TOP SLAB



50S

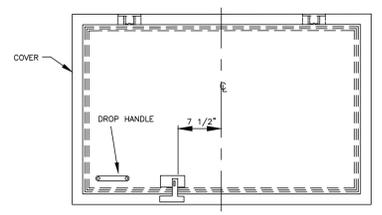

- NOTES:
1. COVER TO BE 1/4\"/>
 - 2. MINIMUM COVER DIMENSIONS - 36\"/>
 - 3. COVER SHALL BE CAST IN PLACE (SEE SPEC SHEET).
 - 4. SPLIT COVER IS REQUIRED FOR LARGER WETWELLS AND/OR VALVE VAULTS.
 - 5. RECESSED HASP IS REQUIRED.
 - 6. TOP AROUND COVER SHALL BE CAST TO THE SAME SIZE AS CONCRETE VALVE VAULT AND CENTERED ON VALVE ASSEMBLY.
 - 7. APPROVED FALL PROTECTION DEVICE IS REQUIRED FOR WET WELL OPENING. THE INSTALLATION SHALL BE PERFORMED BY THE DEVICE MANUFACTURER OR A CONTRACTOR LICENSED BY THE DEVICE MANUFACTURER.

LIFT STATION STANDARD ALUMINUM COVER & PUMP CABLE RACK

53S

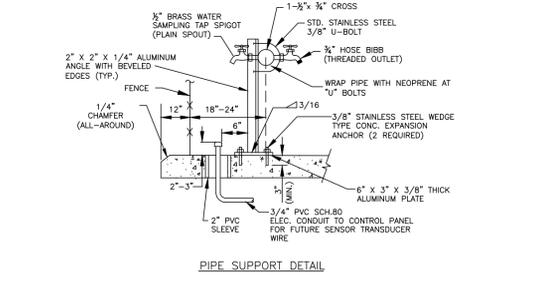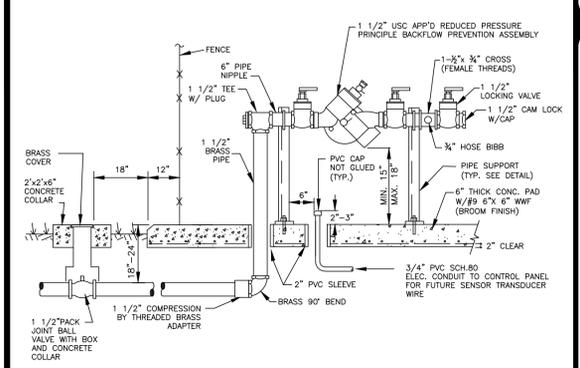

- NOTES:
1. ALL ABOVE GRADE PIPING SHALL BE BRASS OR DUCTILE IRON.
 2. ALL JOINTS SHALL BE THREADED.
 3. FOR LIFT STATION TO BE OWNED BY P.B.C. W.U.D. USE REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY (R.P.P.) LISTED ON THE APPROVED MATERIAL LIST.
 4. THE INITIAL TEST AND CERTIFICATION FOR THE R.P.P. SHALL BE PERFORMED BY THE DEVELOPER PRIOR TO LIFT STATION START-UP.
 5. MIN. 24\"/>
 - 6. THREADED AREAS OF CORPORATION STOP AND OTHER FITTINGS SHALL BE SPIRAL WRAPPED WITH TWO WRAPS OF TEFLON TAPE.


HOSE CONNECTION WITH R.P. BACKFLOW PREVENTER FOR LIFT STATION WATER SERVICE

54S


THIS SPACE INTENTIONALLY LEFT BLANK

THIS SPACE INTENTIONALLY LEFT BLANK

THIS SPACE INTENTIONALLY LEFT BLANK

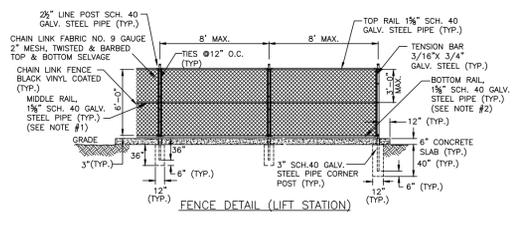


- FENCE DESIGN NOTES FOR "OTHER UTILITY FACILITIES":
1. MIDDLE RAIL REQUIRED ONLY AT CORNERS AND CHANGES OF DIRECTION.
 2. BOTTOM RAIL IS NOT REQUIRED; TENSION WIRE IS REQUIRED WOVEN THROUGH FABRIC AT MAX. 18\"/>

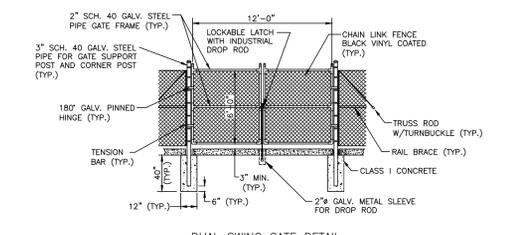

- NOTES:
1. BLACK VINYL COATING IS REQUIRED FOR ALL FENCE FABRIC, ALL POSTS, BRACES, RAILS, AND ACCESSORIES.
 2. ALL POSTS SHALL BE CAPPED WITH GALVANIZED STEEL TOPS. LINE POST TOPS SHALL PROVIDE FOR PASSAGE OF TOP RAIL.
 3. ALL WELDED JOINTS SHALL BE COATED WITH A 2 PART EPOXY PAINT.
 4. RAIL SPLICES TO BE LOCATED WITHIN 12\"/>

FENCE AND GATE DETAIL

55S

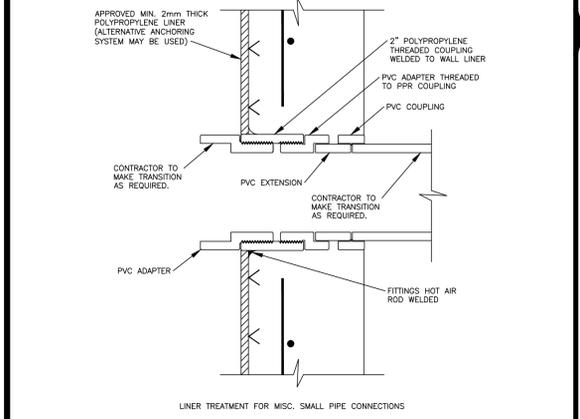

LIFT STATION 2\"/>

51S

LIFT STATION MECHANICAL STANDARD DETAILS, 2 OF 2

CONSULTANT:

DESIGNED BY: WUD
 DRAWN BY: WUD_CADD
 CHECKED BY: A. GALICKI
 APPROVED BY: WUD
 Palm Beach County
 Water Utilities Department
 P.O. Box 16097
 West Palm Beach, FL 33416-6097

IT'S THE LAW!
 CALL 48 HOURS BEFORE YOU DIG
1-800-432 4770
 SUNSHINE STATE ONE CALL OF FLORIDA, INC.
 UTILITIES NOTIFICATION CENTER